


Rev.	Amendments	Date	Made By	Chk'd By

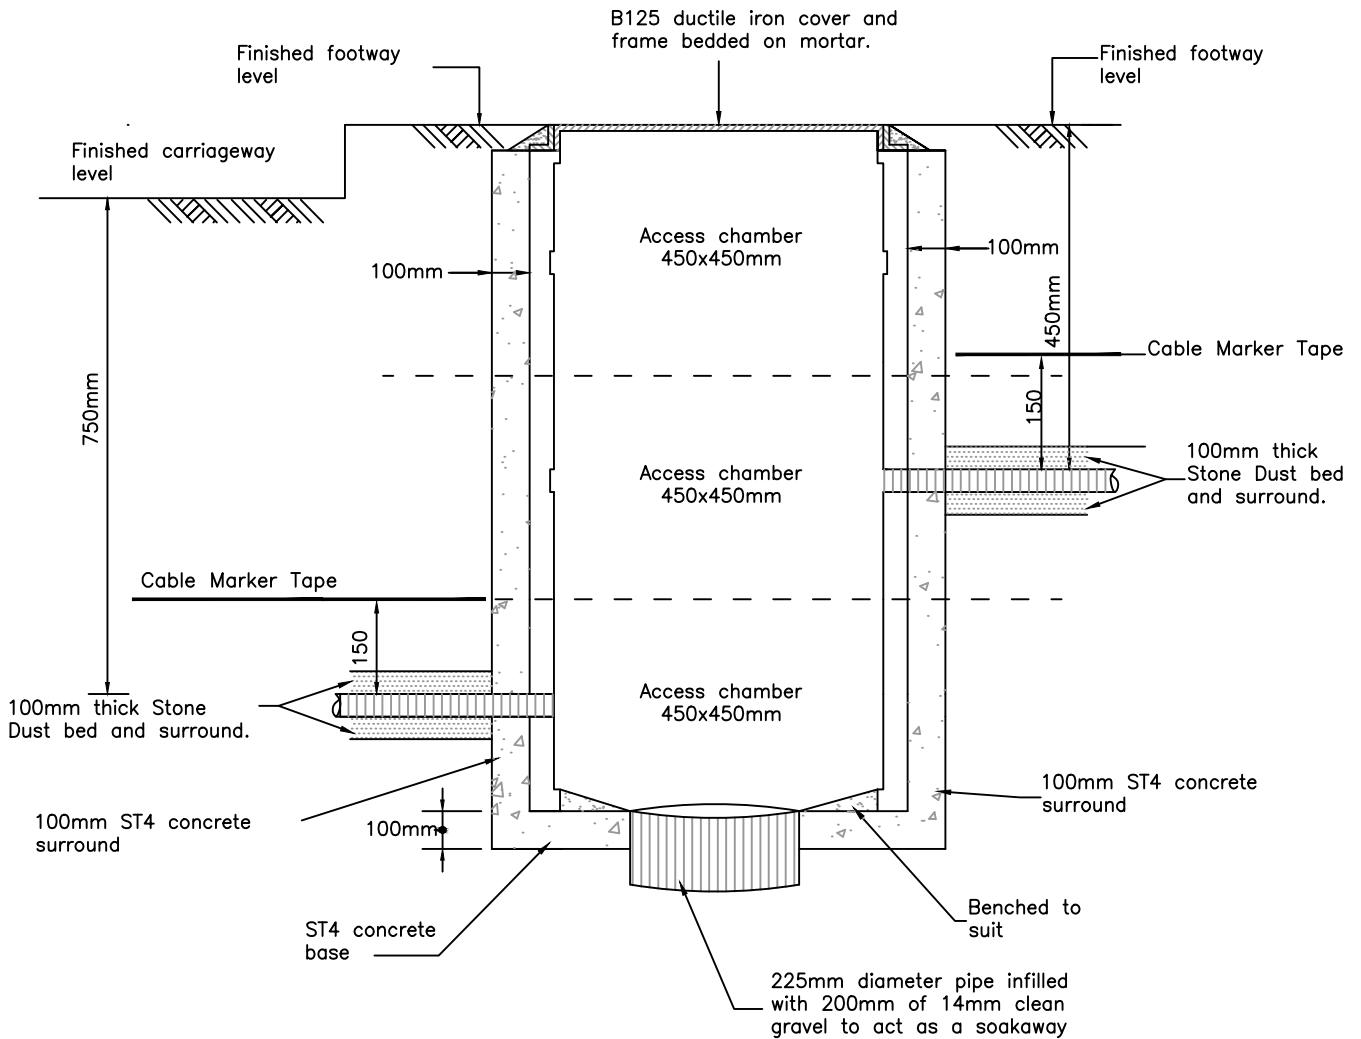

**NOTES**

1. Generally three access chamber sections will give a duct cover depth of 750mm, please see particular Manufactures details to confirm the number of access chambers required.
2. A yellow warning tape inscribed "Caution – Street Lighting Cables Below" is to installed 150 mm above the top of the service ducts after partially backfilling the trench.

**ACCESS CHAMBER – STREET LIGHTING DUCT IN CARRIAGEWAY**

**HIGHWAY DESIGN GUIDE STANDARD DETAILS**

**RHONDDA CYNON TAF  
COUNTY BOROUGH COUNCIL**



Drawn	CLF
Checked	RMD
Date	Jan 14
Scale	NTS
Drg. No.	318
Rev.	