


Rev.	Amendments	Date	Made By	Chk'd By

**NOTE**

All cable glands are to be fitted with brass locknuts.  
 Earth tags are to be fitted to each gland on the inside of the consumer unit with each tag connected individually to the consumer unit earth terminal block.

Stainless Steel Consumer Unit with 100 Amp Double Pole Switch and BS1361 Fuse Carriers with a Minimum of 25% Spare Ways. (Insert Fuse Rating Required) either 8 Way, 12 Way or 18 Way.

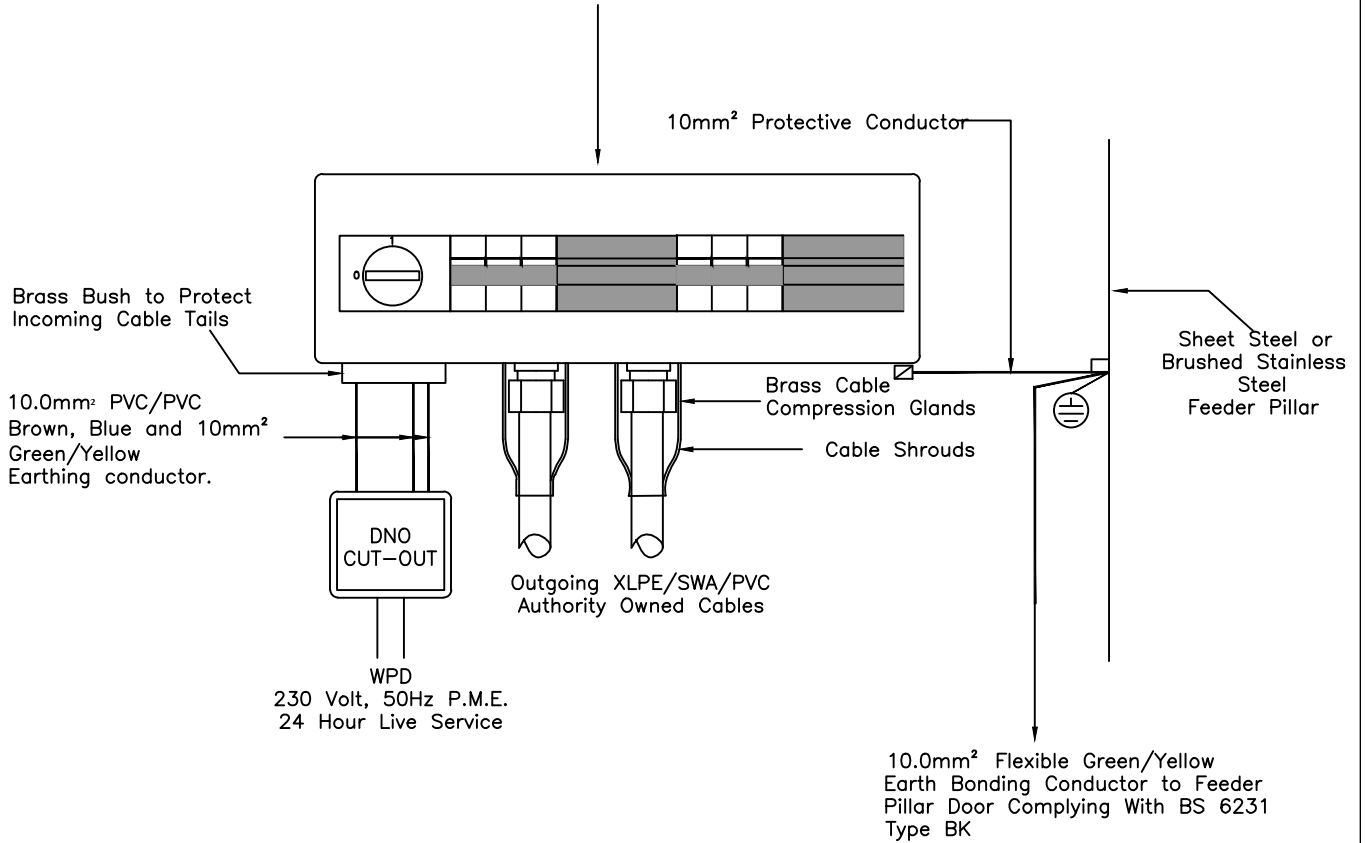

**NOTE**

The size and rating of the Mains Tails + Earth Conductor is relevant to the size and rating of the largest outgoing XLPE/SWA/PVC Authority owned cable

STREET LIGHTING FEEDER PILLAR GENERAL ARRANGEMENT

HIGHWAY DESIGN GUIDE STANDARD DETAILS

RHONDDA CYNON TAF  
 COUNTY BOROUGH COUNCIL



Drawn	CLF
Checked	RMD
Date	Jan 14
Scale	NTS
Drg. No.	313
Rev.	